



**NESHAP RENOVATION / DEMOLITION INSPECTION OF
ASBESTOS CONTAINING MATERIALS
AND OTHER HAZARDOUS WASTE MATERIALS
FOR THE PROPERTY KNOWN AS:**

1445 Park St.
Muskegon, MI 49441

Prepared for:

City of Muskegon
933 Terrace Street - Room 202
Muskegon, MI 49440
231-724-6760

Prepared By:

ETC - Environmental Services
38900 Huron River Drive
Romulus, Michigan 48174
(734) 955-6600

02/09/2016

ETC Job #: 177237

TABLE OF CONTENTS

- 1) Introduction
- 2) Information about Asbestos Inspections
 - a) Sampling Procedures
 - b) PLM Analysis Methodology
 - c) Interpretation of Inspection Results
 - d) Other Hazardous Materials
- 3) Regulatory Requirements
 - a) MIOSHA Construction Asbestos Requirements
 - b) NESHAPs Requirements
 - c) Notification Requirements
 - d) Abatement Requirements
- 4) Summary and Conclusions
 - Chart A – Materials Sampled and Asbestos Content
 - Chart B – Other Hazardous Materials Located
- 5) Inspector's Information/Certification

Appendices

Appendix A - Polarized Light Microscopy Asbestos Analysis Results

Appendix B – Site Map

Appendix C- Photographs

Appendix D - State of Michigan Notification of Intent to Renovate or Demolish

1. Introduction

The City of Muskegon contracted ETC - Environmental Services (ETC) to perform a renovation / demolition inspection of the building located at 1445 Park St., Muskegon, MI 49441 . This inspection was conducted on 02/09/2016.

The EPA under the National Emission Standards for Hazardous Air Pollutants (NESHAPs) asbestos rule requires that prior to the start of a renovation and/or demolition project, the building must be inspected for asbestos containing materials (ACM's). The purpose of this inspection was to determine the presence and quantity of friable or potentially friable ACM's. Depending on the ACM found and the condition that it is in, removal of the material may be necessary before demolition work is to begin. Prior to the start of a demolition project, it is necessary that friable or potentially friable ACM's be removed.

ETC's certified inspector, Aaron Yankee & Stuart Yankee, conducted the ACBM inspection and identified materials suspected of containing asbestos. Aaron Yankee & Stuart Yankee's State of Michigan Asbestos Building Inspector's certification number is A-42490 & A-4115.

Wherever potential asbestos materials were found, data was collected and recorded regarding quantities and observed conditions of the suspect material. As required by the Occupational Safety and Health (OSHA) and the Environmental Protection Agency (EPA), three (3) samples of each type of material were taken in different locations to determine actual asbestos content.

Included along with this report are copies of the bulk sample results, a site map showing sample locations and a copy of the State of Michigan Notification of Intent to Renovate/Demolish. This information will be necessary for the asbestos abatement contractor selected to perform asbestos abatement activities in the house. ETC has included its information on the second page.

2. Information about Asbestos Inspections

a. Sampling Procedures

Representative bulk samples of suspect asbestos containing building materials were randomly collected within each building area. The materials sampled were broken down into distinct homogenous (similar) materials. Homogenous material determination was based on the following criteria:

- Similar physical characteristics (same color and texture, etc.)
- Application (sprayed-on, troweled-on, assembly into a system etc.)
- Material function (Thermal insulation, floor tile, wallboard system etc.)

It is important to note that some companies are only taking one sample of select non-friable materials. While this procedure is allowed under the NESHAPs regulation, the OSHA standard suggests a minimum of three samples of each

homogeneous material. This is a better approach due the potential errors in the analytical method used. **To provide the most accurate information possible and be sure of our results, ETC chooses to take three samples of each sampled material.**

Additionally, some inspection companies have taken to assuming that materials contain asbestos rather than paying for the time and expenses of sampling them. This is not if the clients best interest. If materials are being assumed to contain asbestos, the client must treat them as asbestos containing even if they are not. This can lead to significantly increased costs for the building owner. **In general, ETC only assumes materials to be asbestos when sampling them will ruin their integrity (i.e. fire doors) or when they are too dangerous to sample (i.e. live electrical lines).**

b. PLM Analysis Methodology

PLM samples were analyzed utilizing the Environmental Protection Agency's Test Methods: Methods for the determination of Asbestos in Bulk Building Materials (EPA 600/R-93/116, July 1993) and the McCrone Research Institute's The Asbestos Particle Atlas as method references. Additional treatment and tests may be required to accurately define composition (i.e. ashing, extraction, acetone treatment, and TEM).

Analysis was performed by using the bulk sample for visual observation and slide preparation(s) for microscopic examination and identification. The samples analyzed for asbestos (chrysotile, amosite, crocidolite, anthophyllite, and actinolite/tremolite), fibrous non-asbestos constituents (mineral wool, cellulose, etc.) and non-fibrous constituents. Using a stereoscope, the microscopist visually estimated relative amounts of each constituent by determining the volume of each constituent in proportion to the total volume of the sample.

According to NESHAP requirements any bulk sample that has asbestos content above 0% but below 10% should be point counted for final determination of percentage. **Please note, the contract DID NOT include point counting as defined in NESHAP.** Should City of Muskegon wish to have this additional analysis conducted, ETC can send any samples in this range for point counting. However, this will require additional charges for analysis. Therefore, for any samples in the range above 0% but below 10% these results can only be considered estimates.

c. Interpretation of Inspection Results

A material is considered by OSHA, the EPA and the State of Michigan to be asbestos-containing if at least one sample collected from the homogenous material has asbestos fibers present in a concentration greater than one percent (>1 %).

A summary of the materials sampled, asbestos content, quantities and locations can be found on the Chart A in Section 4.0 – Summary and Conclusions.

d. Other Hazardous Materials

Additionally, a chart showing other hazardous materials (above the household quantity limitations) found at the site is included in Chart B – Section 4.0 – Summary and Conclusions. This lists non-asbestos materials that may be hazardous and require special handling and disposal requirements. Items that might be in this category include things like mercury switches, florescent lighting tubes, halogen lights, Freon in refrigeration units, pesticides, herbicides, paints, solvents, etc.

However, under the Resource Conservation and Recovery Act (RCRA) that addresses hazardous wastes, there is residential household quantity exclusion. Therefore, these materials will only be listed in this chart if they are present in quantities larger than what would be expected in a normal household. For instance, if the home was a farm and had a 55 gallon drum of pesticide present, this would be listed in Chart B. On the other hand if there were a few pesticide containers present as would be found in most homes these materials would not be listed.

3. Regulatory Requirements

There are two main regulations that affect renovation / demolition of residential homes and asbestos materials. The MIOSHA asbestos construction standard has requirements to protect the workers performing the renovation / demolition while the EPA – NESHAPs regulation has requirements that protect the general public and environment.

a. MIOSHA Construction Asbestos Regulations

The MIOSHA standard establishes a permissible exposure limit (PEL) average over an 8 hour day. This means that this is the maximum level of asbestos that workers and/or employees can be exposed to without respirator protection and protective clothing. Should air sampling during renovation or demolition activities be at or near the PEL the employer will have to:

- Notify Workers
- Worker Training
- Post Danger Signs
- Establish periodic air monitoring regulated areas, and decontamination facilities
- Provide respiratory protection and personnel protective clothing
- Employee Respiration Monitoring
- Record keeping

- Medical Surveillance (if employee will be exposed 30 days per year or more).

Until recently, only schools were federally mandated to conduct asbestos inspections of their buildings. However, with the passage of new MIOSHA regulations, all building owners (in this case City of Muskegon) is now required to notify all renovation / demolition workers of presence, location and quantity of all asbestos containing building materials within the building.

In most cases, it is more practical to have an asbestos contractor removal the ACM from the building prior to renovation / demolition than have the renovation / demolition contractor comply with all these requirements.

b. NESHAP Requirements

Prior to beginning a renovation or demolition project, NESHAP (enforced in Michigan by the Department of Environmental Quality – MDEQ) requires a full inspection of the following materials to determine their asbestos content:

- Friable Materials
- Category 1 – Non-friable Materials (Packings, gaskets, resilient floor covering, and asphalt roofing products)
- Category II – Non-friable Materials (All other non-friable materials)

In general, MDEQ requires any identified asbestos materials to be removed prior to renovation or demolition activities that would dislodge, disturb or otherwise affect these materials. There is an exception that if a licensed supervisor will state in writing that the material will not become friable during the renovation / demolition process it may be left in the building. However, be very careful with this exemption. MDEQ has stated that they believe that the only materials that MIGHT qualify for this exemption would be roofing felt and asphalt roofing materials. In order to use even this small exemption, the following would be required from the demolition contractor:

- A licensed asbestos abatement supervisor will sign that the material will not become friable
- The supervisor will have to be on-site during all renovation or demolition to insure that material stays intact.
- If MDEQ reviews that site and finds the material crumbled or disturbed both the contractor and building owner may be cited up to \$27500 per day.
- The waste generated from the activity must be taken to an asbestos dump and they must be informed that the waste is mixed asbestos waste.

It is obviously very expensive and difficult to try and leave ACM within and area / building during renovation or demolition activities. Therefore, ETC recommends that all ACM be removed. This is why ETC does not assume materials to be ACM.

c. Notification Requirements

When performing abatement work within the State of Michigan, notification requirements depend on the quantity of materials and the friability of the material being removed.

If removing friable material above >160 square feet and / or 260 linear feet, the contractor must provide a ten working day notification to Michigan Department of Environmental Quality (MDEQ) and a ten calendar day notification to Michigan Department of Licensing and Regulatory Affairs (LARA) – Asbestos Program. If only non-friable materials are being removed, MDEQ does not want a notification.

If removing above >15 square feet but < 160 square feet, or > 10 linear feet but < 260 linear feet the contractor only needs to notify the LARA as stated above.

For removals of < 15 square feet or < 10 linear feet, not notification is required.

In conjunction with any notification to LARA, the contractor must pay a 1% fee for the project. This fee is to reflect 1% of the total abatement contract amount.

d. Abatement Requirements

Any company hired to remove identified ACM must insure that all asbestos companies, supervisors, workers are be licensed by the LARA. Additionally, these companies must insure that:

- The State of Michigan must be notified of the work in advance
- An asbestos supervisor must be on-site at all times when work is occurring
- All work must be completed within regulated work areas
- All work must be completed utilizing asbestos work practices defined in the MIOSHA regulations
- Have on-site personnel sampling conducted during the removal activities
- The contractor must request and pass (below 0.05 f/cc) a final asbestos clearance performed by a neutral third party prior to dismantling and leaving the site.
- Meet all other current regulations and standards.

In addition to these requirements, ETC strongly recommends that City of Muskegon insure that they receive the following documents from the contractor prior to making final payment:

- Written / signed documentation from the supervisor if any asbestos materials are to be left in place during renovation or demolition (Not recommended)
- Copy of the asbestos abatement notification
- Copy of the personnel monitoring during the work

- Copy of the final asbestos clearance report

By requiring these documents, City of Muskegon will substantially reduce their liability should something occur during the asbestos removal at this site.

4. Summary and Conclusions

ETC has endeavored to identify potential asbestos containing materials (ACM) that were accessible (without destructive testing) at the time of the inspection, other potential ACM may be buried or inaccessible at the time of the initial survey.

As has been evidenced on numerous other demolition and renovation projects, when tearing out or demolishing existing building surfaces, it is very common to encounter other building materials that were not accessible during the initial testing for ACM or lead / cadmium painted surfaces. It is therefore incumbent on City of Muskegon or their selected construction / renovation contractor to refer to the chart of sampled materials consistently during the renovation process. If materials are encountered during this process that are not clearly identifiable on the initial survey chart, ETC should be called to test and verify the asbestos / lead / cadmium content of these items.

ETC cannot be held responsible for materials encountered after the initial survey is completed unless we are contacted and given the opportunity to test and verify the material content. The costs associated with this additional testing are not included within the scope of this project and will incur additional charges for the additional sampling and analysis.

On the following charts, please find:

- Chart A - Is a summary of the materials that were sampled. Materials that test positive for asbestos have been bolded to make identification easier. ***If additional materials are encountered that were not previously identified, the contractor is responsible to contact ETC and have these materials tested. These additional sampling costs are not included in the scope of work or price for this survey.***

Quantities that are listed are estimates only; in general, listed quantities represent only what was visible during testing. It is likely that where ACM has been identified throughout specific floors, similar materials and quantities exist on other like floors. It is the contractors'/client's responsibility to verify all amounts of asbestos identified during any bid process, or during future renovation and/or demolition activities. Materials that are identical in both relative location and physical description to already tested materials listed in this report should always be assumed to be ACM.

Chart A – Materials Sampled and Asbestos Content

Material #	Material Description	Asbestos	Quantity	Location (Refer to map in Appendix B)
1	Plaster, White Base, White Finish	No	4500 SF	Throughout
2	Finish Plaster, Texture/Popcorn, White	No	350 SF	Rooms 3, 4 & 10
3	Duct Wrap, Gray, Paper, On Boots	Yes	20 SF	Throughout
4	Chimney Cement	No	2 SF	Room 11
5	Floor Tile, 12x12, Green, Marble	No	150 SF	Room 1
6	Floor Tile, 12x12, Red/Tan	No	50 SF	Room 1
7	Floor Tile, 12x12, Black	No	440 SF	Room 2
8	Floor Tile, 9x9, White	Yes	25 SF	Room 2
9	Mastic, Under Material 8	Yes	25 SF	Room 2
10	Floor Paper, Black Paper	No	25 SF	Room 2
11	Linoleum, Black	No	25 SF	Room 7
12	Stair Tread, Tan/Brown	Yes	25 SF	Room 7
13	Stair Glue, Tan/Brown	No	50 SF	Room 7
14	Linoleum, Layers, Blue White / On Wall Behind Shower	No	50 SF	Rooms 2 & 5
15	Floor Tile, Brown, 9x9	Yes	300 SF	Rooms 7 & 9
16	Mastic, Black, Under Material 15	Yes	300SF	Rooms 7 & 9
17	Linoleum, Under Sink	No	12 SF	Room 6
18	Vapor Barrier, Gray Under, 12x12, Ceramic	No	50 SF	Room 5
19	Linoleum, Red, Under Ceramic	Yes	190 SF	Rooms 6 & 10

**Chart A – Materials Sampled and Asbestos Content
(Continued)**

20	Drywall, White	No	1100 SF
21	Tape, White	No	1700 SF
22	Mud / Joint Compound, White	No	1100 SF
23	Linoleum, Countertops	No	30 SF
24	Window Glaze, Exterior Wood	No	19 Units
25	House Wrap, Black, Under Wood Shake	No	2200 SF
26	House Wrap	No	2,200 SF
27	Roof, Grey Shingles	No	1,400 SF
28	Roof, Red Shingles	No	1,400 SF
29	Blown In Insulation, White	No	1,000 SF

- Chart B – Is a list of other hazardous materials (above RCRA household quantity levels) that will require special handling and disposal by the contractor.

**Chart B – Other Hazardous Materials Located
(Above the household quantity Limitations)**

Material #	Material Description	Quantity	Location
1	Stove/Oven	1	Room 6
2	Dehumidifiers	1	Room 11
3	Smoke Detectors	3	Rooms 3, 9 & 11
4	Thermostats	1	Room 2
5	Florescent Light Bulbs – CFL Bulb & Floor Bulb	3	Rooms 5, 10 & 11

5. Inspector's Information

All inspection work was completed by a Michigan certified asbestos abatement inspector as detailed below.

This report reviewed and submitted by:



Two handwritten signatures in cursive script, one on the left and one on the right, positioned above a horizontal line.

Aaron Yankee & Stuart Yankee
State of Michigan Certified Asbestos Building Inspector
State of Michigan Card #: A-42490 & A-4115

APPENDICES

APPENDIX A

POLARIZED LIGHT MICROSCOPY ASBESTOS ANALYSIS RESULT FORMS

ENVIRONMENTAL TESTING LABORATORIES, INC.



38900 HURON RIVER DRIVE, SUITE 200
ROMULUS, MICHIGAN 48174
(734) 955-6600
FAX: (734) 955-6604

To : Environmental Testing And Consulting Inc.
38900 Huron River Drive
Romulus, MI 48174

Project Location : Vacant Residence
1445 Park St., Muskegon, MI

Attention : Samantha Ferguson

Client Project : N/A

ETC Job : 177237

Report Date : 2/17/2016

Login #	Sample ID	Work Requested	Completed
394152	01A	Asbestos Analysis	02/17/2016
394153	01B	Asbestos Analysis	02/17/2016
394154	01C	Asbestos Analysis	02/17/2016
394155	01D	Asbestos Analysis	02/17/2016
394156	01E	Asbestos Analysis	02/17/2016
394157	01F	Asbestos Analysis	02/17/2016
394158	01G	Asbestos Analysis	02/17/2016
394159	02A	Asbestos Analysis	02/17/2016
394160	02B	Asbestos Analysis	02/17/2016
394161	02C	Asbestos Analysis	02/17/2016
394162	03A	Asbestos Analysis	02/17/2016
394163	03B	Asbestos Analysis	02/17/2016
394164	03C	Asbestos Analysis	02/17/2016
394165	04A	Asbestos Analysis	02/17/2016
394166	04B	Asbestos Analysis	02/17/2016
394167	05A	Asbestos Analysis	02/17/2016
394168	05B	Asbestos Analysis	02/17/2016
394169	06A	Asbestos Analysis	02/17/2016
394170	06B	Asbestos Analysis	02/17/2016
394171	07A	Asbestos Analysis	02/17/2016

Login #	Sample ID	Work Requested	Completed
394172	07B	Asbestos Analysis	02/17/2016
394173	08A	Asbestos Analysis	02/17/2016
394174	08B	Asbestos Analysis	02/17/2016
394175	09A	Asbestos Analysis	02/17/2016
394176	09B	Asbestos Analysis	02/17/2016
394177	10A	Asbestos Analysis	02/17/2016
394178	10B	Asbestos Analysis	02/17/2016
394179	11A	Asbestos Analysis	02/17/2016
394180	11B	Asbestos Analysis	02/17/2016
394181	12A	Asbestos Analysis	02/17/2016
394182	12B	Asbestos Analysis	02/17/2016
394183	13A	Asbestos Analysis	02/17/2016
394184	13B	Asbestos Analysis	02/17/2016
394185	14A	Asbestos Analysis	02/17/2016
394186	14B	Asbestos Analysis	02/17/2016
394187	15A	Asbestos Analysis	02/17/2016
394188	15B	Asbestos Analysis	02/17/2016
394189	16A	Asbestos Analysis	02/17/2016
394190	16B	Asbestos Analysis	02/17/2016
394191	17A	Asbestos Analysis	02/17/2016
394192	17B	Asbestos Analysis	02/17/2016
394193	18A	Asbestos Analysis	02/17/2016
394194	18B	Asbestos Analysis	02/17/2016
394195	19A	Asbestos Analysis	02/17/2016
394196	19B	Asbestos Analysis	02/17/2016
394197	20A	Asbestos Analysis	02/17/2016
394198	20B	Asbestos Analysis	02/17/2016

Login #	Sample ID	Work Requested	Completed
394199	21A	Asbestos Analysis	02/17/2016
394200	22B	Asbestos Analysis	02/17/2016
394201	22A	Asbestos Analysis	02/17/2016
394202	22B	Asbestos Analysis	02/17/2016
394203	23A	Asbestos Analysis	02/17/2016
394204	23B	Asbestos Analysis	02/17/2016
394205	24A	Asbestos Analysis	02/17/2016
394206	24B	Asbestos Analysis	02/17/2016
394207	25A	Asbestos Analysis	02/17/2016
394208	25B	Asbestos Analysis	02/17/2016
394209	26A	Asbestos Analysis	02/17/2016
394210	26B	Asbestos Analysis	02/17/2016
394211	27A	Asbestos Analysis	02/17/2016
394212	27B	Asbestos Analysis	02/17/2016
394213	28A	Asbestos Analysis	02/17/2016
394214	28B	Asbestos Analysis	02/17/2016
394215	29A	Asbestos Analysis	02/17/2016
394216	29B	Asbestos Analysis	02/17/2016

Reviewed by:



Quality Assurance Coordinator

Polarized Light Microscopy Asbestos Analysis Report

To : Environmental Testing And Consulting Inc.
 38900 Huron River Drive
 Romulus, MI 48174
Location : Vacant Residence
 1445 Park St., Muskegon, MI

ETC Job : 177237
Client Project : N/A
Date Collected : 02/09/2016
Date Received : 02/11/2016
Date Analyzed : 02/17/2016

Sample	Description	Appearance	% Fibrous	% Non-Fibrous	% Asbestos
394152 01A LR 2, N Wall Layer-1 Analyst: Kaylin Carey	Plaster	White Non-Fibrous Homogenous	3% Cellulose	97% Other	None Detected
394152 01A LR 2, N Wall Layer-2 Analyst: Kaylin Carey	Skim Coat	White Non-Fibrous Homogenous	2% Cellulose	98% Other	None Detected
394153 01B BR 3, S Wall Layer-1 Analyst: Kaylin Carey	Plaster	White Non-Fibrous Homogenous	3% Cellulose	97% Other	None Detected
394153 01B BR 3, S Wall Layer-2 Analyst: Kaylin Carey	Skim Coat	White Non-Fibrous Homogenous	2% Cellulose	98% Other	None Detected
394154 01C BR 4, E Wall Layer-1 Analyst: Kaylin Carey	Plaster	White Non-Fibrous Homogenous	3% Cellulose	97% Other	None Detected
394154 01C BR 4, E Wall Layer-2 Analyst: Kaylin Carey	Skim Coat	White Non-Fibrous Homogenous	2% Cellulose	98% Other	None Detected

ETL, Inc. maintains liability limited to cost of analysis. This report relates only to the samples reported and may not be reproduced without written approval by ETL, Inc. Test Method EPA 600/R-93-116 & EPA 600/M4-82/020 or NYSDOH-ELAP item 198.1 and/or 198.6 was used to analyze all samples. Matrix interference and/or resolution limits (i.e. detecting asbestos in non-friable organically bound materials) may yield false results in certain circumstances. Quantitative transmission electron microscopy (TEM) is currently the only method that can pronounce materials as non-asbestos containing. Interpretation and use of test results are the responsibility of the client. ETL, Inc. is not responsible for the accuracy of the results when requested to physically separate and analyze layered samples. Any PLM results below 10% should be re-analyzed using the EPA recommended Point Count method. Any material that has greater than 1% asbestos content is considered to be an Asbestos Containing Material (ACM). These materials are regulated by both OSHA and the EPA and must be treated accordingly. Results are related to only to samples that were tested.

Polarized Light Microscopy Asbestos Analysis Report

To : Environmental Testing And Consulting Inc.
 38900 Huron River Drive
 Romulus, MI 48174
Location : Vacant Residence
 1445 Park St., Muskegon, MI

ETC Job : 177237
Client Project : N/A
Date Collected : 02/09/2016
Date Received : 02/11/2016
Date Analyzed : 02/17/2016

Sample	Description	Appearance	% Fibrous	% Non-Fibrous	% Asbestos
394155 01D Bath 5, S Wall Layer-1 Analyst: Kaylin Carey	Plaster	White Non-Fibrous Homogenous	3% Cellulose	97% Other	None Detected
394155 01D Bath 5, S Wall Layer-2 Analyst: Kaylin Carey	Skim Coat	White Non-Fibrous Homogenous	2% Cellulose	98% Other	None Detected
394156 01E Bath 5, Clg Layer-1 Analyst: Kaylin Carey	Plaster	White Non-Fibrous Homogenous	3% Cellulose	97% Other	None Detected
394156 01E Bath 5, Clg Layer-2 Analyst: Kaylin Carey	Skim Coat	White Non-Fibrous Homogenous	2% Cellulose	98% Other	None Detected
394157 01F KN 6, E Wall Layer-1 Analyst: Kaylin Carey	Plaster	White Non-Fibrous Homogenous	3% Cellulose	97% Other	None Detected
394157 01F KN 6, E Wall Layer-2 Analyst: Kaylin Carey	Skim Coat	White Non-Fibrous Homogenous	2% Cellulose	98% Other	None Detected

Polarized Light Microscopy Asbestos Analysis Report

To : Environmental Testing And Consulting Inc.
 38900 Huron River Drive
 Romulus, MI 48174
Location : Vacant Residence
 1445 Park St., Muskegon, MI

ETC Job : 177237
Client Project : N/A
Date Collected : 02/09/2016
Date Received : 02/11/2016
Date Analyzed : 02/17/2016

Sample	Description	Appearance	% Fibrous	% Non-Fibrous	% Asbestos
394158 01G Bsmt Str 10, W Wall Layer-1 Analyst: Kaylin Carey	Plaster	White Non-Fibrous Homogenous	3% Cellulose	97% Other	None Detected
394158 01G Bsmt Str 10, W Wall Layer-2 Analyst: Kaylin Carey	Skim Coat	White Non-Fibrous Homogenous	2% Cellulose	98% Other	None Detected
394159 02A BR 3, Clg Layer-1 Analyst: Kaylin Carey	Finish Plaster (popcorn texture)	White Non-Fibrous Homogenous	3% Cellulose	97% Other	None Detected
394159 02A BR 3, Clg Layer-2 Analyst: Kaylin Carey	Skim Coat	White Non-Fibrous Homogenous	2% Cellulose	98% Other	None Detected
394160 02B BR 3, Clg Layer-1 Analyst: Kaylin Carey	Finish Plaster (popcorn texture)	White Non-Fibrous Homogenous	3% Cellulose	97% Other	None Detected
394160 02B BR 3, Clg Layer-2 Analyst: Kaylin Carey	Skim Coat	White Non-Fibrous Homogenous	1% Cellulose	99% Other	None Detected



Polarized Light Microscopy Asbestos Analysis Report

To : Environmental Testing And Consulting Inc.
38900 Huron River Drive
Romulus, MI 48174
Location : Vacant Residence
1445 Park St., Muskegon, MI

ETC Job : 177237
Client Project : N/A
Date Collected : 02/09/2016
Date Received : 02/11/2016
Date Analyzed : 02/17/2016

Sample	Description	Appearance	% Fibrous	% Non-Fibrous	% Asbestos
394161 02C BR 4, Clg Layer-1 Analyst: Kaylin Carey	Finish Plaster (popcorn texture)	White Non-Fibrous Homogenous	3% Cellulose	97% Other	None Detected
394161 02C BR 4, Clg Layer-2 Analyst: Kaylin Carey	Skim Coat	White Non-Fibrous Homogenous	1% Cellulose	99% Other	None Detected
394162 03A Bsmt 11 Analyst: Kaylin Carey	Paper Duct Wrap (on boots)	Grey Fibrous Homogenous		80% Other	20% Chrysotile
394163 03B Bsmt 11 Analyst: Kaylin Carey	Paper Duct Wrap (on boots)	Grey Fibrous Homogenous		80% Other	20% Chrysotile
394164 03C LR 2 Analyst: Kaylin Carey	Paper Duct Wrap (on boots)	Grey Fibrous Homogenous		80% Other	20% Chrysotile
394165 04A Bsmt 11 Analyst: Kaylin Carey	Chimney Cement	Grey Non-Fibrous Homogenous		100% Other	None Detected
394166 04B Bsmt 11 Analyst: Kaylin Carey	Chimney Cement	Grey Non-Fibrous Homogenous	3% Cellulose	97% Other	None Detected

Polarized Light Microscopy Asbestos Analysis Report

To : Environmental Testing And Consulting Inc.
 38900 Huron River Drive
 Romulus, MI 48174
Location : Vacant Residence
 1445 Park St., Muskegon, MI

ETC Job : 177237
Client Project : N/A
Date Collected : 02/09/2016
Date Received : 02/11/2016
Date Analyzed : 02/17/2016

Sample	Description	Appearance	% Fibrous	% Non-Fibrous	% Asbestos
394167 05A Porch 1 Analyst: Kaylin Carey	12x12 Marble Patterned Floor Tile	Green Non-Fibrous Homogenous		100% Other	None Detected
394168 05B Porch 1 Analyst: Kaylin Carey	12x12 Marble Patterned Floor Tile	Green Non-Fibrous Homogenous		100% Other	None Detected
394169 06A Porch 1 Analyst: Kaylin Carey	12x12 Floor Tile	Red/Tan Non-Fibrous Homogenous		100% Other	None Detected
394170 06B Porch 1 Analyst: Kaylin Carey	12x12 Floor Tile	Red/Tan Non-Fibrous Homogenous		100% Other	None Detected
394171 07A LR 2 Layer-1 Analyst: Kaylin Carey	12x12 Floor Tile	Black Non-Fibrous Homogenous		100% Other	None Detected
394171 07A LR 2 Layer-2 Analyst: Kaylin Carey	Mastic	Black Non-Fibrous Homogenous		100% Other	None Detected

ETL, Inc. maintains liability limited to cost of analysis. This report relates only to the samples reported and may not be reproduced without written approval by ETL, Inc. Test Method EPA 600/R-93-116 & EPA 600/M4-82/020 or NYSDOH-ELAP item 198.1 and/or 198.6 was used to analyze all samples. Matrix interference and/or resolution limits (i.e. detecting asbestos in non-friable organically bound materials) may yield false results in certain circumstances. Quantitative transmission electron microscopy (TEM) is currently the only method that can pronounce materials as non-asbestos containing. Interpretation and use of test results are the responsibility of the client. ETL, Inc. is not responsible for the accuracy of the results when requested to physically separate and analyze layered samples. Any PLM results below 10% should be re-analyzed using the EPA recommended Point Count method. Any material that has greater than 1% asbestos content is considered to be an Asbestos Containing Material (ACM). These materials are regulated by both OSHA and the EPA and must be treated accordingly. Results are related to only to samples that were tested.

Polarized Light Microscopy Asbestos Analysis Report

To : Environmental Testing And Consulting Inc.
 38900 Huron River Drive
 Romulus, MI 48174
Location : Vacant Residence
 1445 Park St., Muskegon, MI

ETC Job : 177237
Client Project : N/A
Date Collected : 02/09/2016
Date Received : 02/11/2016
Date Analyzed : 02/17/2016

Sample	Description	Appearance	% Fibrous	% Non-Fibrous	% Asbestos
394172 07B LR 2 Layer-1 Analyst: Kaylin Carey	12x12 Floor Tile	Black Non-Fibrous Homogenous		100% Other	None Detected
394172 07B LR 2 Layer-2 Analyst: Kaylin Carey	Mastic	Black Non-Fibrous Homogenous		100% Other	None Detected
394173 08A LR 2, CL Under Strs Analyst: Kaylin Carey	9x9 Floor Tile	White Non-Fibrous Homogenous		95% Other	5% Chrysotile
394174 08B LR 2, CL Under Strs Analyst: Kaylin Carey	9x9 Floor Tile	White Non-Fibrous Homogenous		95% Other	5% Chrysotile
394175 09A LR 2, CL Under Strs Analyst: Kaylin Carey	Mastic (under mat 08)	Black Non-Fibrous Homogenous		98% Other	2% Chrysotile
394176 09B LR 2, CL Under Strs Analyst: Kaylin Carey	Mastic (under mat 08)	Black Non-Fibrous Homogenous		98% Other	2% Chrysotile
394177 10A LR 2, CL Under Strs Analyst: Kaylin Carey	Floor Paper	Black Fibrous Homogenous	80% Cellulose	20% Other	None Detected

ETL, Inc. maintains liability limited to cost of analysis. This report relates only to the samples reported and may not be reproduced without written approval by ETL, Inc. Test Method EPA 600/R-93-116 & EPA 600/M4-82/020 or NYSDOH-ELAP item 198.1 and/or 198.6 was used to analyze all samples. Matrix interference and/or resolution limits (i.e. detecting asbestos in non-friable organically bound materials) may yield false results in certain circumstances. Quantitative transmission electron microscopy (TEM) is currently the only method that can pronounce materials as non-asbestos containing. Interpretation and use of test results are the responsibility of the client. ETL, Inc. is not responsible for the accuracy of the results when requested to physically separate and analyze layered samples. Any PLM results below 10% should be re-analyzed using the EPA recommended Point Count method. Any material that has greater than 1% asbestos content is considered to be an Asbestos Containing Material (ACM). These materials are regulated by both OSHA and the EPA and must be treated accordingly. Results are related to only to samples that were tested.

Polarized Light Microscopy Asbestos Analysis Report

To : Environmental Testing And Consulting Inc.
38900 Huron River Drive
Romulus, MI 48174
Location : Vacant Residence
1445 Park St., Muskegon, MI

ETC Job : 177237
Client Project : N/A
Date Collected : 02/09/2016
Date Received : 02/11/2016
Date Analyzed : 02/17/2016

Sample	Description	Appearance	% Fibrous	% Non-Fibrous	% Asbestos
394178 10B LR 2, CL Under Strs Analyst: Kaylin Carey	Floor Paper	Black Fibrous Homogenous	80% Cellulose	20% Other	None Detected
394179 11A Str 7 Analyst: Kaylin Carey	Linoleum	Black Fibrous Homogenous	80% Cellulose	20% Other	None Detected
394180 11B Str 7 Analyst: Kaylin Carey	Linoleum	Black Fibrous Homogenous	80% Cellulose	20% Other	None Detected
394181 12A Str 7 Analyst: Kaylin Carey	Stair Tread	Tan/Brown Non-Fibrous Homogenous		97% Other	3% Chrysotile
394182 12B Str 7 Analyst: Kaylin Carey	Stair Tread	Tan/Brown Non-Fibrous Homogenous		97% Other	3% Chrysotile
394183 13A Str 7 Analyst: Kaylin Carey	Stair Glue	Tan/Brown Non-Fibrous Homogenous		100% Other	None Detected
394184 13B Str 7 Analyst: Kaylin Carey	Stair Glue	Tan/Brown Non-Fibrous Homogenous		100% Other	None Detected

Polarized Light Microscopy Asbestos Analysis Report

To : Environmental Testing And Consulting Inc.
 38900 Huron River Drive
 Romulus, MI 48174
Location : Vacant Residence
 1445 Park St., Muskegon, MI

ETC Job : 177237
Client Project : N/A
Date Collected : 02/09/2016
Date Received : 02/11/2016
Date Analyzed : 02/17/2016

Sample	Description	Appearance	% Fibrous	% Non-Fibrous	% Asbestos
394185 14A LR 2, Under Strs Analyst: Kaylin Carey	Linoleum (on wall behind shower)	Blue/White Fibrous Homogenous	80% Cellulose	20% Other	None Detected
394186 14B Bath 5, Behind Shower Analyst: Kaylin Carey	Linoleum (on wall behind shower)	Blue/White Fibrous Homogenous	80% Cellulose	20% Other	None Detected
394187 15A Rm 9 Analyst: Kaylin Carey	9x9 Floor Tile	Brown Non-Fibrous Homogenous		97% Other	3% Chrysotile
394188 15B Rm 7 Analyst: Kaylin Carey	9x9 Floor Tile	Brown Non-Fibrous Homogenous		97% Other	3% Chrysotile
394189 16A Rm 9 Analyst: Kaylin Carey	Mastic (under mat 15)	Black Non-Fibrous Homogenous		98% Other	2% Chrysotile
394190 16B Rm 7 Analyst: Kaylin Carey	Mastic (under mat 15)	Black Non-Fibrous Homogenous		98% Other	2% Chrysotile
394191 17A KN 6 Analyst: Kaylin Carey	Linoleum (under sink)	Brown Fibrous Homogenous		100% Other	None Detected

ETL, Inc. maintains liability limited to cost of analysis. This report relates only to the samples reported and may not be reproduced without written approval by ETL, Inc. Test Method EPA 600/R-93-116 & EPA 600/M4-82/020 or NYSDOH-ELAP item 198.1 and/or 198.6 was used to analyze all samples. Matrix interference and/or resolution limits (i.e. detecting asbestos in non-friable organically bound materials) may yield false results in certain circumstances. Quantitative transmission electron microscopy (TEM) is currently the only method that can pronounce materials as non-asbestos containing. Interpretation and use of test results are the responsibility of the client. ETL, Inc. is not responsible for the accuracy of the results when requested to physically separate and analyze layered samples. Any PLM results below 10% should be re-analyzed using the EPA recommended Point Count method. Any material that has greater than 1% asbestos content is considered to be an Asbestos Containing Material (ACM). These materials are regulated by both OSHA and the EPA and must be treated accordingly. Results are related to only to samples that were tested.

Polarized Light Microscopy Asbestos Analysis Report

To : Environmental Testing And Consulting Inc.
 38900 Huron River Drive
 Romulus, MI 48174
Location : Vacant Residence
 1445 Park St., Muskegon, MI

ETC Job : 177237
Client Project : N/A
Date Collected : 02/09/2016
Date Received : 02/11/2016
Date Analyzed : 02/17/2016

Sample	Description	Appearance	% Fibrous	% Non-Fibrous	% Asbestos
394192 17B KN 6 Analyst: Kaylin Carey	Linoleum (under sink)	Brown Fibrous Homogenous		100% Other	None Detected
394193 18A Bath 5 Analyst: Kaylin Carey	Vapor Barrier (under 12x12 ceramic tile)	Grey Fibrous Homogenous	80% Cellulose	20% Other	None Detected
394194 18B Bath 5 Analyst: Kaylin Carey	Vapor Barrier (under 12x12 ceramic tile)	Grey Fibrous Homogenous	80% Cellulose	20% Other	None Detected
394195 19A KN 6 Layer-1 Analyst: Ian McCusker	Linoleum (under ceramic)	Red Non-Fibrous Homogenous		98% Other	2% Chrysotile
394195 19A KN 6 Layer-2 Analyst: Ian McCusker	Paper Backing	Black Fibrous Homogenous	100% Cellulose		None Detected
394196 19B KN 6 Layer-1 Analyst: Ian McCusker	Linoleum (under ceramic)	Red Non-Fibrous Homogenous		97% Other	3% Chrysotile
394196 19B KN 6 Layer-2 Analyst: Ian McCusker	Paper Backing	Black Fibrous Homogenous	100% Cellulose		None Detected

Polarized Light Microscopy Asbestos Analysis Report

To : Environmental Testing And Consulting Inc.
 38900 Huron River Drive
 Romulus, MI 48174
Location : Vacant Residence
 1445 Park St., Muskegon, MI

ETC Job : 177237
Client Project : N/A
Date Collected : 02/09/2016
Date Received : 02/11/2016
Date Analyzed : 02/17/2016

Sample	Description	Appearance	% Fibrous	% Non-Fibrous	% Asbestos
394197 20A KN 6, Walls & Ceiling Analyst: Ian McCusker	Drywall	White Non-Fibrous Homogenous		100% Other	None Detected
394198 20B LR 2, Clg Analyst: Ian McCusker	Drywall	White Non-Fibrous Homogenous		100% Other	None Detected
394199 21A KN 6 Analyst: Ian McCusker	Tape	White Fibrous Homogenous	100% Cellulose		None Detected
394200 22B KN 6 Analyst: Ian McCusker	Tape	White Fibrous Homogenous	100% Cellulose		None Detected
394201 22A KN 6 Analyst: Ian McCusker	Mud/Joint Compound	White Non-Fibrous Homogenous	3% Cellulose	97% Other	None Detected
394202 22B KN 6 Analyst: Ian McCusker	Mud/Joint Compound	White Non-Fibrous Homogenous	3% Cellulose	97% Other	None Detected
394203 23A KN 6 Analyst: Ian McCusker	Linoleum (from countertops)	Black Non-Fibrous Homogenous	50% Cellulose	50% Other	None Detected

Polarized Light Microscopy Asbestos Analysis Report

To : Environmental Testing And Consulting Inc.
 38900 Huron River Drive
 Romulus, MI 48174
Location : Vacant Residence
 1445 Park St., Muskegon, MI

ETC Job : 177237
Client Project : N/A
Date Collected : 02/09/2016
Date Received : 02/11/2016
Date Analyzed : 02/17/2016

Sample	Description	Appearance	% Fibrous	% Non-Fibrous	% Asbestos
394204 23B KN 6 Analyst: Ian McCusker	Linoleum (from countertops)	Black Non-Fibrous Homogenous	50% Cellulose	50% Other	None Detected
394205 24A Porch, Ext Analyst: Ian McCusker	Window Glaze (from exterior wood)	Grey Non-Fibrous Homogenous		100% Other	None Detected
394206 24B Bsm, Ext Analyst: Ian McCusker	Window Glaze (from exterior wood)	Grey Non-Fibrous Homogenous		100% Other	None Detected
394207 25A Ext, E Analyst: Ian McCusker	House Wrap (under wood shake)	Black Fibrous Homogenous	100% Cellulose		None Detected
394208 25B Ext, W Analyst: Ian McCusker	House Wrap (under wood shake)	Black Fibrous Homogenous	100% Cellulose		None Detected
394209 26A Ext, E Analyst: Ian McCusker	House Wrap (under wood siding)	Tan Fibrous Homogenous	100% Cellulose		None Detected
394210 26B Ext, W Analyst: Ian McCusker	House Wrap (under wood siding)	Tan Fibrous Homogenous	100% Cellulose		None Detected

ETL, Inc. maintains liability limited to cost of analysis. This report relates only to the samples reported and may not be reproduced without written approval by ETL, Inc. Test Method EPA 600/R-93-116 & EPA 600/M4-82/020 or NYSDOH-ELAP item 198.1 and/or 198.6 was used to analyze all samples. Matrix interference and/or resolution limits (i.e. detecting asbestos in non-friable organically bound materials) may yield false results in certain circumstances. Quantitative transmission electron microscopy (TEM) is currently the only method that can pronounce materials as non-asbestos containing. Interpretation and use of test results are the responsibility of the client. ETL, Inc. is not responsible for the accuracy of the results when requested to physically separate and analyze layered samples. Any PLM results below 10% should be re-analyzed using the EPA recommended Point Count method. Any material that has greater than 1% asbestos content is considered to be an Asbestos Containing Material (ACM). These materials are regulated by both OSHA and the EPA and must be treated accordingly. Results are related to only to samples that were tested.

Polarized Light Microscopy Asbestos Analysis Report

To : Environmental Testing And Consulting Inc.
 38900 Huron River Drive
 Romulus, MI 48174
Location : Vacant Residence
 1445 Park St., Muskegon, MI

ETC Job : 177237
Client Project : N/A
Date Collected : 02/09/2016
Date Received : 02/11/2016
Date Analyzed : 02/17/2016

Sample	Description	Appearance	% Fibrous	% Non-Fibrous	% Asbestos
394211 27A Ext, N Analyst: Kaylin Carey	Roof Shingle	Grey Non-Fibrous Homogenous		100% Other	None Detected
394212 27B Ext, N Analyst: Kaylin Carey	Roof Shingle	Grey Non-Fibrous Homogenous		100% Other	None Detected
394213 28A Ext, N Analyst: Kaylin Carey	Roof Shingle	Red Non-Fibrous Homogenous		100% Other	None Detected
394214 28B Ext, N Analyst: Kaylin Carey	Roof Shingle	Red Non-Fibrous Homogenous		100% Other	None Detected
394215 29A Attic Analyst: Kaylin Carey	Blown-In Insulation	White Fibrous Homogenous	100% Mineral wool		None Detected


ETL, Inc. maintains liability limited to cost of analysis. This report relates only to the samples reported and may not be reproduced without written approval by ETL, Inc. Test Method EPA 600/R-93-116 & EPA 600/M4-82/020 or NYSDOH-ELAP item 198.1 and/or 198.6 was used to analyze all samples. Matrix interference and/or resolution limits (i.e. detecting asbestos in non-friable organically bound materials) may yield false results in certain circumstances. Quantitative transmission electron microscopy (TEM) is currently the only method that can pronounce materials as non-asbestos containing. Interpretation and use of test results are the responsibility of the client. ETL, Inc. is not responsible for the accuracy of the results when requested to physically separate and analyze layered samples. Any PLM results below 10% should be re-analyzed using the EPA recommended Point Count method. Any material that has greater than 1% asbestos content is considered to be an Asbestos Containing Material (ACM). These materials are regulated by both OSHA and the EPA and must be treated accordingly. Results are related to only to samples that were tested.

Polarized Light Microscopy Asbestos Analysis Report

To : Environmental Testing And Consulting Inc.
 38900 Huron River Drive
 Romulus, MI 48174
Location : Vacant Residence
 1445 Park St., Muskegon, MI

ETC Job : 177237
Client Project : N/A
Date Collected : 02/09/2016
Date Received : 02/11/2016
Date Analyzed : 02/17/2016

Sample	Description	Appearance	% Fibrous	% Non-Fibrous	% Asbestos
394216 29B Attic Analyst: Kaylin Carey	Blown-In Insulation	White Fibrous Homogenous	100% Mineral wool		None Detected



Lab Supervisor/Other Signatory



Analyst: Ian McCusker



Analyst: Kaylin Carey

400 Point Count Results by EPA 600/R-93/116 PLM (denoted by "PC")
 Item 198.1: PLM Methods for Identifying and Quantitating Asbestos in Bulk Samples
 Item 198.6: PLM Methods for Identifying and Quantitating Asbestos in Non-Friable Organically Bound Bulk Samples
 EPA 600/R-93/116: Method for Determination of Asbestos in Bulk Building Materials
 EPA 600/M4-82-020: Interim Method for Determination of Asbestos in Bulk Insulation Samples

ETL, Inc. maintains liability limited to cost of analysis. This report relates only to the samples reported and may not be reproduced without written approval by ETL, Inc. Test Method EPA 600/R-93-116 & EPA 600/M4-82/020 or NYSDOH-ELAP item 198.1 and/or 198.6 was used to analyze all samples. Matrix interference and/or resolution limits (i.e. detecting asbestos in non-friable organically bound materials) may yield false results in certain circumstances. Quantitative transmission electron microscopy (TEM) is currently the only method that can pronounce materials as non-asbestos containing. Interpretation and use of test results are the responsibility of the client. ETL, Inc. is not responsible for the accuracy of the results when requested to physically separate and analyze layered samples. Any PLM results below 10% should be re-analyzed using the EPA recommended Point Count method. Any material that has greater than 1% asbestos content is considered to be an Asbestos Containing Material (ACM). These materials are regulated by both OSHA and the EPA and must be treated accordingly. Results are related to only to samples that were tested.

ENVIRONMENTAL TESTING LABORATORIES, INC

38900 Huron River Drive
 Romulus, Michigan 48174
 (734) 955-6600
 Fax: (734) 992-2261
www.2etil.com

**Bulk Asbestos
 Chain of Custody**

ETL Project #:

Client: ETC	Contact: AARON YANKEE STUART YANKEE	Project Location/name: MUSKEGON BRIGHT 1445 PARK ST.
	Phone:	
Address: Romulus	Fax:	Client Project #: 177237
	E-mail:	
Please Provide Results: <input type="checkbox"/> Email <input type="checkbox"/> Fax <input type="checkbox"/> Verbal <input type="checkbox"/> Other _____		Date Sampled: 2-9-16

Turnaround Time (TAT): RUSH Same Day 24 hr 48 hr Standard (3+ days) Other _____

PLM Instructions
 (Check all that apply)

<input checked="" type="checkbox"/> PLM EPA600/R-93/116, 1993 (Standard method)	<input type="checkbox"/> Stop at 1st Positive - Clearly mark Homogenous Group
<input type="checkbox"/> Point Counting: 400 Points*	
<input type="checkbox"/> PLM Non-Building Material (Dust, Wipe, Tape)	<input type="checkbox"/> Soil or Vermiculite Analysis *

* Additional charge and turnaround may be required

Lab ID	Sample ID	Sample Location	Material Description
394152	01A - 01G	<i>See</i> <i>SAMPLE</i> <i>SUMMARY sheets</i>	
thru	02A - 03C		
394216	04A - 29B		

		Date	Time
Relinquished (Name/Organization):	STU YANKEE/ETC	2-9-16	am/pm
Received (Name/ETL):		2/11/16	am/pm
Stereoscopic Analysis (Name/ETL):	<i>Koj Og</i>	2/15/16	am/pm
Sample Login (Name/ETL):		2/11/16	am/pm
Analysis (Name/ETL):	<i>Koj Og</i>	2/15/16	am/pm
QA/QC Review (Name/ETL):			am/pm

Special Instructions:	Remarks
-----------------------	---------

Asbestos Material Sampling Summary Sheet

Surfacing materials

Revision date 5/7/2015

Job #:	Building:				Date:		
Material no.	Material Description	Friable (F) / Non-Friable (NF)	Sample Letter	Sample Location	Material Located throughout bldg (Please List all Rooms)	Quantity	Picture #
01	Material: PLASTER	F	A	LIV 2 N wall	394152	throughout	4500 SF
	WHITE BASE		B	BED 3 S wall	394153		
	WHITE FINISH		C	BED 4 E wall	394154		
			D	BATH 5 S wall	394155		
			E	BATH 5 ceiling	394156		
			F	KITCHEN 6 E wall	394157		
			G	BASEMENT STAIR 10 W wall	394158		
02	Material: FINISH PLASTER	F	A	BED 3 ceiling	394159	3, 4, 10	350 SF
	TEXTURE / POPCORN		B	BED 3 ceiling	394160		
	WHITE		C	BED 4 ceiling	394161		
	Material:						

000 SF = 3 samples

1000 - <5000 = 5 samples

>5000 = 7 samples

Asbestos Material Sampling Summary Sheet
TSI (Thermal System Insulation) materials

Revision date 5/7/2015

Job #: 177237		Building: 1445 PARK ST			Date: 2-9-16		
Material no.	Material Description	Friable (F) / Non-Friable (NF)	Sample Letter	Sample Location	Material Located throughout bldg (Please List all Rooms)	Quantity	Picture #
03	Material: DUCT WRAP	F	A	BASEMENT // 394162	th throughout	20 SF	
	Description: GRAY PAPER ON BOOTS		B	BASEMENT // 394163			
			C	LIV 2 394164			
	Material:						
	Description:						
	Material:						
	Description:						
	Material:						
	Description:						
	Material:						
	Description:						
	Material:						
	Description:						

3 samples with the exception of patches less than 6 LF or 6 SF, then only 1 sample

Asbestos Material Sampling Summary Sheet
Miscellaneous materials

Revision date 5/7/2015

Job #: 177237		Building: 1445 PARK ST			Date: 2-9-16		
Material no.	Material Description	Friable (F) / Non-Friable (NF)	Sample Letter	Sample Location	Material Located throughout bldg (Please List all Rooms)	Quantity	Picture #
04	Material: CHIMNEY CEMENT	NF	A	BASEMENT // 394165	//	2 SF	
	Description		B	BASEMENT // 394166			
05	Material: FLOOR TILE	F	A	PORCH 1 394167	1	150 SF	
	Description		B	PORCH 1 394168			
06	Material: FLOOR TILE	F	A	PORCH 1 394169	1	50 SF	
	Description		B	PORCH 1 394170			
07	Material: FLOOR TILE	F	A	LIV 2 394171	2	440 SF	
	Description		B	LIV 2 394172			
08	Material: FLOOR TILE	F	A	LIV 2 - closet 394173	2	25 SF	
	Description		B	under 394174			
09	Material: MASTIC	NF	A	394175 STAIRS	2	25 SF	
	Description		B	394176			
10	Material: FLOOR PAPER	F	A	2 2 394177	2	25 SF	
	Description		B	394178			
11	Material: LINOLEUM	F	A	STAIR 7 394179	7	25 SF	
	Description		B	STAIR 7 394180			
12	Material: STAIR TREAD	F	A	7 394181	7	25 SF	
	Description		B	7 394182			
13	Material: STAIR GLUE	NF	A	7 394183	7	50 SF	
	Description		B	7 394184			

Asbestos Material Sampling Summary Sheet
Miscellaneous materials

Revision date 5/7/2015

Job #: 177237		Building: 1445 PARK ST			Date: 2-9-16		
Material no.	Material Description	Friable (F) / Non-Friable (NF)	Sample Letter	Sample Location	Material Located throughout bldg (Please List all Rooms)	Quantity	Picture #
14	Material: LINOLEUM LAYERS	F	A	LIV 2 nd - UNDER STAIRS	394185	25	50
	Description: BLUE WHITE / ON WALL BEHIND SHOWER		B	BATH 5 - BEHIND SHOWER			
15	Material: FLOOR TILE	F	A	9	394187	7.9	300 SF
	Description: BROWN 9x9		B	7	394188		
16	Material: MASTIC	NF	A	9	394189	7.9	300 SF
	Description: BLACK UNDER #15		B	7	394190		
17	Material: LINOLEUM	F	A	KIT 6	394191	6	12 SF
	Description: UNDER SINK		B	"	394192		
18	Material: VAPOR BARRIER	F	A	BATH 5	394193	5	50 SF
	Description: GRAY UNDER 12x12" CERAMIC		B	"	394194		
19	Material: LINOLEUM	NF	A	KIT 6	394195	6.10	190 SF
	Description: RED UNDER CERAMIC		B	"	394196		
20	Material: DRYWALL	F	A	KIT 6 WALLS/ceiling	394197	2.6	1100 SF
	Description: WHITE		B	LIV 2 ceiling	394198		
21	Material: TAPE	F	A	KIT 6	394199	2.6	1100 SF
	Description: WHITE		B	KIT 6	394200		
22	Material: MUD/JOINT COMPOUND	F	A	KIT 6	394201	2.6	1100 SF
	Description: WHITE		B	KIT 6	394202		
23	Material: LINOLEUM	F	A	KIT 6	394203	6	30 SF
	Description: COUNTERTOPS		B	KIT 6	394204		

Asbestos Material Sampling Summary Sheet
Miscellaneous materials


Revision date 5/7/2015

Job #: 177237		Building: 1445 PARK ST			Date: 2-9-16		
Material no.	Material Description	Friable (F) / Non-Friable (NF)	Sample Letter	Sample Location	Material Located throughout bldg (Please List all Rooms)	Quantity	Picture #
24	Material: WINDOW GLAZ	F	A	PORCH EXT 394205			
	Description: EXT WOOD		B	BASEMENT EXT 394206			
25	Material: HOUSE WRAP	F	A	EXTERIOR EAST 394207			
	Description: WOOD BLACK UNDER SHAKE		B	EXT. WEST 394208			
26	Material: HOUSE WRAP	F	A	EXT. EAST 394209			
	Description: TAN UNDER WOOD SIDING		B	EXT. WEST (UNDER #25) 394210			
27	Material: Roof	NF	A	EXT North 394211			
	Description: GRAY SHINGLE		B	EXT 394212			
28	Material: Roof	NF	A	EXT 394213			
	Description: RED SHINGLE		B	EXT UNDER #27 394214			
29	Material: BLOWN IN	F	A	ATTIC 394215			
	Description: WHITE		B	ATTIC 394216			
	Material:						
	Description:						
	Material:						
	Description:						
	Material:						
	Description:						

APPENDIX B

SITE MAP


2nd floor & Attic

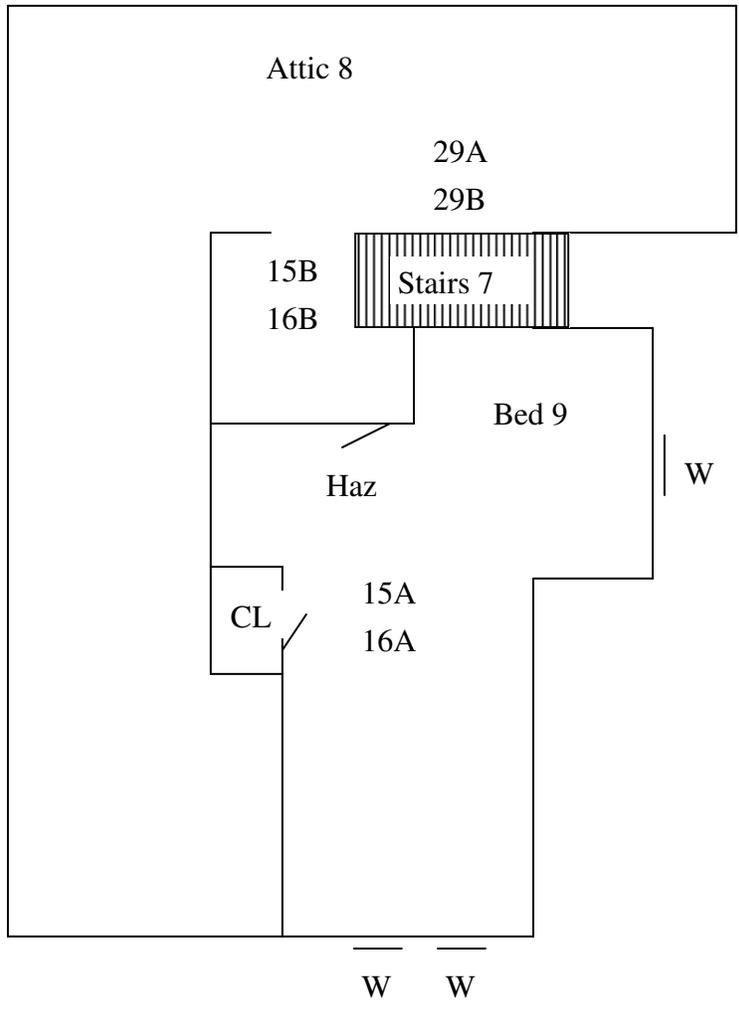

Please Note: This is a rough floor plan only. All items, (doorways, Windows, etc.) may not be included in this illustration. Also, room and component sizes are not drawn to scale.



Basement

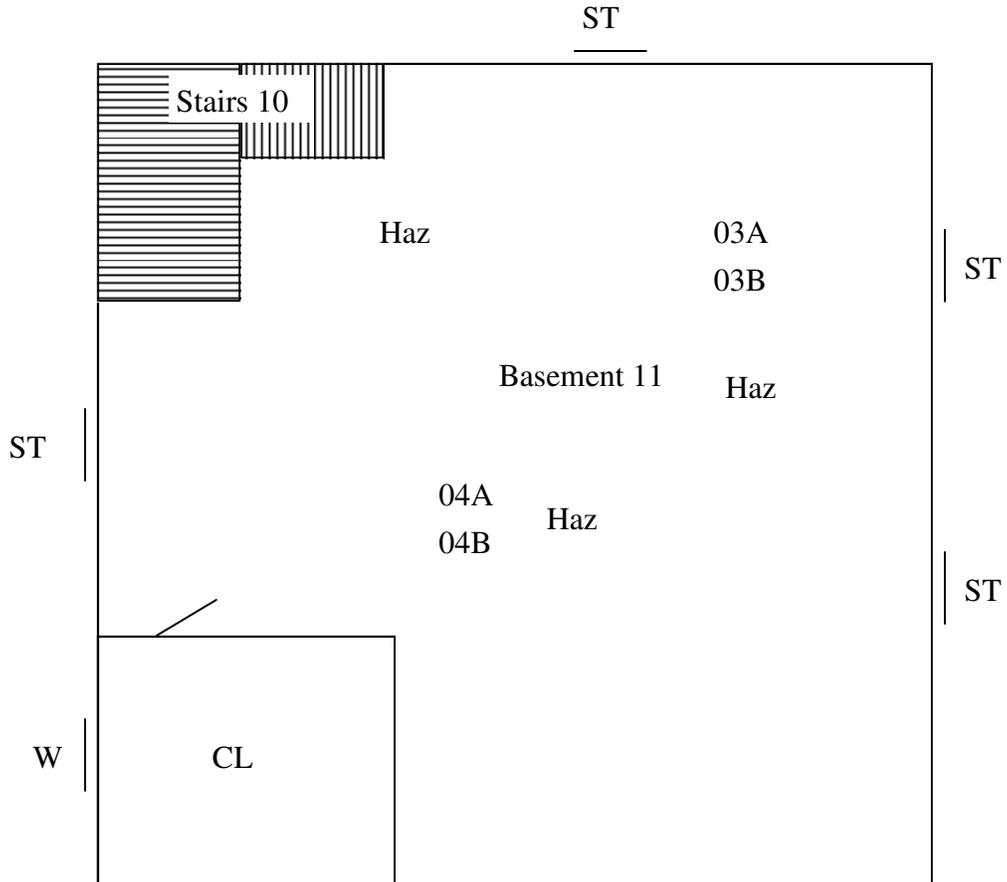

Please Note: This is a rough floor plan only. All items, (doorways, Windows, etc.) may not be included in this illustration. Also, room and component sizes are not drawn to scale.



APPENDIX C

PHOTOGRAPHS



Side A



Side B



Side C



Side D



Hazard : Stove /Oven



Hazard : Dehumidifier



Hazard : Smoke Detector



Hazard : Smoke Detector



Hazard : Smoke Detector



Hazard : Thermostat



Hazard : Florescent Light Bulbs



Hazard : Florescent Light Bulbs



Hazard : Florescent Light bulbs

APPENDIX D

STATE OF MICHIGAN NOTIFICATION OF INTENT TO REMOVE/DEMOLISH

NOTIFICATION OF INTENT TO RENOVATE/DEMOLISH



MICHIGAN DEPARTMENT OF ENVIRONMENTAL QUALITY
(MDEQ) AIR QUALITY DIVISION
NESHAP, 40 CFR Part 61, Subpart M



MICHIGAN DEPARTMENT OF LICENSING AND
REGULATORY AFFAIRS (LARA), ASBESTOS PROGRAM,
P.A. 135 OF 1986, AS AMENDED, Section 220 (1-4) or (8)

DEQ/LARA USE ONLY

Postmark Date ___/___/___ Rec'd Date ___/___/___
 Emergency Date ___/___/___ Valid No. _____
 OK Send Def Ltr. Date of Def Ltr. ___/___/___
 FOLLOW UP ___/___/___ Spoke w/ _____
 Comments: _____

 Notification No. _____ Trans No. _____

Calculate LARA Asbestos Project Fee: (1% Project Fee)
 Total Project Cost: _____ x 0.01 = _____
 Type of Contractor: _____ License No.: _____
 Licensing Authority: _____

1. NOTIFICATION:
 Date of Notification: _____
 Date of Revision(s): _____
 Notification Type: Original Revised Canceled Annual
Mark appropriate boxes: (both DEQ and LARA may apply):
DEQ (NESHAP) [260 In. ft./160 sq. ft. or more is threshold]
 Planned Renovation – 10 working days notice
 Emergency Renovation
 Scheduled Demolition – 10 working days notice
 Intentional Burn – 10 working days notice
 Ordered Demolition
LARA (MIOSHA) [Will not accept annual notifications]
 Demo, Reno, Encap. (>10 In. ft./15 sq. ft.) 10 calendar days notice
 Emergency Renovation/Encapsulation

2. PROJECT SCHEDULE:

	START DATE	END DATE
* Renovation	_____	_____
+Asb. Removal	_____	_____
+Demolition:	_____	_____
Encapsulation:	_____	_____

Work Schedule: Please indicate the anticipated days of the week and work hours for the purpose of scheduling a compliance inspection.

	Days of the Week	Work Hours
Asb. Removal:	_____	_____
Demolition:	_____	_____
Encapsulation:	_____	_____

* Includes setup, build enclosure, asbestos removal, demobilizing, etc.
 +Include only those dates you are conducting asbestos removal/demo.
 Check here if this is a multi-phased project, attach a schedule showing the start/end date of each phase.

3. ABATEMENT CONTRACTOR: Internal Project #: _____
 Name: _____
 Mailing Address: _____
 City/State/Zip: _____
 E-mail: _____
 Contact: _____ Phone: _____

4. DEMOLITION CONTRACTOR: Internal Project #: _____
 Name: _____
 Mailing Address: _____
 City/State/Zip: _____
 E-mail: _____
 Contact: _____ Phone: _____

5. FACILITY OWNER: ("Facility" includes Bridges)
 Name: _____
 Mailing Address: _____
 City/State/Zip: _____
 E-mail: _____
 Contact: _____ Phone: _____

6. FACILITY DESCRIPTION:
 Facility Name: _____
 Location Address/Description: _____
 _____ If Apt. # of units: _____
 City/Twp. _____ State: _____ Zip Code: _____
 County: _____ Nearest Crossroad: _____
 Size: (sq. ft.) _____ No. of Floors: _____ Floor No.: _____
 Age: _____ Present Use: _____ Prior Use: _____
 Specific Location(s) in Facility: _____

7. DISPOSAL SITE:
 Name: _____
 Location Address: _____
 City/State/Zip: _____

8. WASTE TRANSPORTER 1:	WASTE TRANSPORTER 2:
Name: _____	_____
Address: _____	_____
City/State/Zip: _____	_____
Phone: _____	_____

9. ORDERED DEMOLITIONS: (See NESHAP regulations for definition of "Ordered Demolition.") A copy of the official Order must accompany this notification.
 Gov't Agency Ordering Demo: _____
 Name/Title of Person Signing Order: _____

 Date of Order: _____ Date Ordered to Begin: _____

10. IS ASBESTOS PRESENT? Yes No To be removed prior to demolition

Estimate the amount of asbestos: Include RACM (Regulated Asbestos Containing Material) to be removed, encapsulated, etc. Also include the amount and type (floor tile, roofing, etc.) of non-friable Category I and/or Category II ACM that will not be removed prior to demolition. (NOTE: In a demolition, cementitious ACM cannot remain in a structure, as it is likely to become regulated in the demolition/handling process. It must be removed prior to demolition.)

RACM to be Removed	RACM to be Encapsulated	Non-friable ACM <u>not</u> removed prior to demo.		Units of Measure	
		Category I	Category II	Ln. Ft.	Ln. M.
				<input type="checkbox"/> Sq. Ft.	<input type="checkbox"/> Sq. M.
				<input type="checkbox"/> Cu. Ft.*	<input type="checkbox"/> Cu.M.*

*Volume (cubic ft./meters) should be used only if unable to measure by linear/square measure (example: asbestos has fallen off of surface).

NOTIFICATION OF INTENT TO RENOVATE/DEMOLISH (continued)

11. PROJECT DESCRIPTION: Complete A) for Renovation (asbestos removal/encapsulation) and/or B) for Demolition:

A) RENOVATION: Mark all surfaces/types of RACM to be removed:

- Piping Fittings Boiler(s) Tanks(s)
 Beam(s) Duct(s) Tunnel(s) Ceiling Tile(s)
 Mag Block Other (describe) _____

Encapsulation (for LARA): Mark surfaces/types to be encapsulated:

- Piping Fittings Boiler(s) Tank(s)
 Beam(s) Duct(s) Tunnel(s) Ceiling Tile(s)
 Other (describe) _____

Method of removal: Describe how the asbestos will be removed from the surface (example: glove bag, scrape with hand tools, cut in sections and carefully lower, etc.): _____

B) DEMOLITION: Describe the method of demolition of facility, bridge, etc., and indicate if complete or partial. If partial, describe which part of facility bridge, etc., will be demolished: _____

12. ENGINEERING CONTROLS: Describe work practices and engineering controls used to prevent visible emissions before, during, and after removal, and until proper disposal: _____

13. UNEXPECTED ASBESTOS: Describe the steps you intend to follow in the event that unexpected RACM is found or previously non-friable asbestos becomes friable (crumbled, pulverized, reduced to powder, etc.) and therefore regulated: _____

14. PROCEDURE(S) USED TO DETECT THE PRESENCE OF ASBESTOS: A) Indicate how you determined whether or not asbestos is in the facility. If analytical sampling was used, describe method of analysis. (The determination of the presence or absence of asbestos must be made prior to submitting a renovation/demolition notification.): _____

B) Name, address, and phone number of company performing asbestos survey: _____

C) Name, accreditation number of inspector, and date of inspection: _____

15. EMERGENCY RENOVATIONS: Date/time of emergency: _____ Describe the sudden, unexpected event: _____

Explain how the event caused unsafe conditions, and/or would cause equipment damage and/or an unreasonable financial burden: _____

16. I certify that an individual trained in the provisions of 40 CFR Part 61, Subpart M, will be on-site during the renovation and during demolition involving RACM above the threshold and/or during an ordered demolition. Evidence that this person has completed the required training will be available for inspection at the renovation or demolition site.

Signature of Owner or Abatement Contractor Date

Signature of Owner or Demolition Contractor Date

17. Signature Requirements for Projects with Negative Pressure Enclosures: (required by LARA)

Per Section 221(1)(2) of P.A. 135 of 1986, as amended, clearance air monitoring is required for any asbestos abatement project involving 10 linear feet/15 square feet or more of friable material which is performed within a negative pressure enclosure. *I (the building owner or lessee) have been advised by the contractor of my responsibility under Act 135 to have clearance air monitoring performed on this project.*

Signature of Building Owner or Lessee Date

Signature of Asbestos Abatement Contractor Representative Date

NOTE: It is not mandatory that a signed copy be sent to LARA unless requested. For affected projects, this section of the notification form must be completed, signed, and made part of your records before the project begins.

18. I certify that the above information is correct:

Printed Name of Owner/Operator Date

Signature of Owner/Operator Date

MAILING ADDRESSES/PHONE NUMBERS: (See Item 1 to determine which agency requirements/regulations are applicable to your project.)

For **Public Act 135 of 1986, as amended, Section 220 (1-4) or (8)**, mail to address below. For more info visit: <http://www.michigan.gov/asbestos>

For **NESHAP Demolitions/Renovations, 40 CFR, Part 61, Subpart M**, mail notifications to the appropriate address below (by county of subject facility): For more info visit <http://www.michigan.gov/deq> click on Air, then Asbestos NESHAP Program.

All Counties (except Wayne County)

NESHAP Asbestos Program
 DEQ, AQD
 P.O. Box 30260
 Lansing, MI 48909-7760

Wayne County Only

NESHAP Asbestos Program
 Detroit Field Office, DEQ, AQD
 Cadillac Place, Suite 2-300
 3058 West Grand Boulevard
 Detroit, MI 48202

517.241.7463 (Office)
 517.373.7064 (Revision Line)

313.456.4686 (Office)
 313.456.2558 (Revision Line)

MIOSHA Asbestos Program
 LARA, CSHD
 P.O. Box 30671
 Lansing, MI 48909-8171

517.636.4551 (office), 517.322.1713 (fax)